




Real Time Alerts.


The Real Time software provides you with Real Time alerts for late or missed checks.

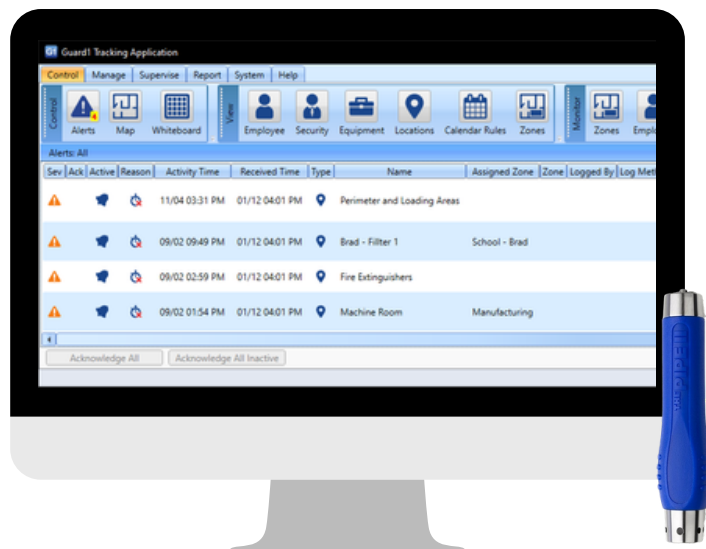

Alerts can be sent out as text and email alerts too!


Live Monitoring.

Monitor location checks and alerts in Real Time as they are happening.

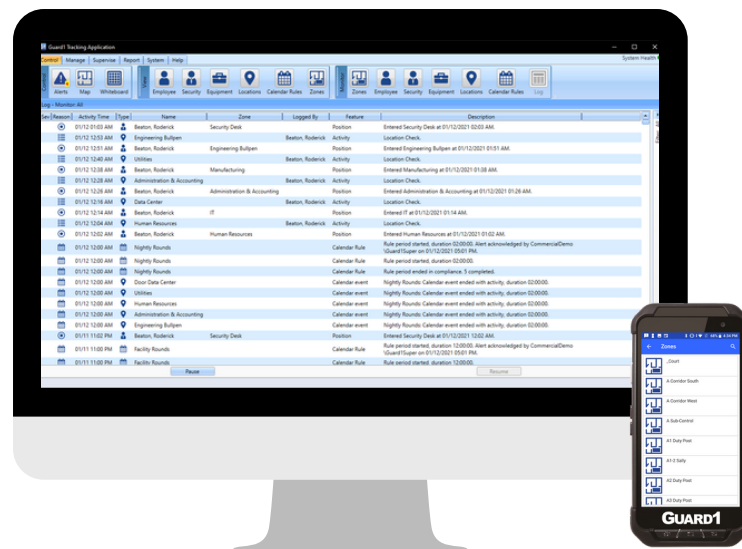


Information uploads in real time over WiFi from the mobile device.


Real Time RFID Mobile Device Technology

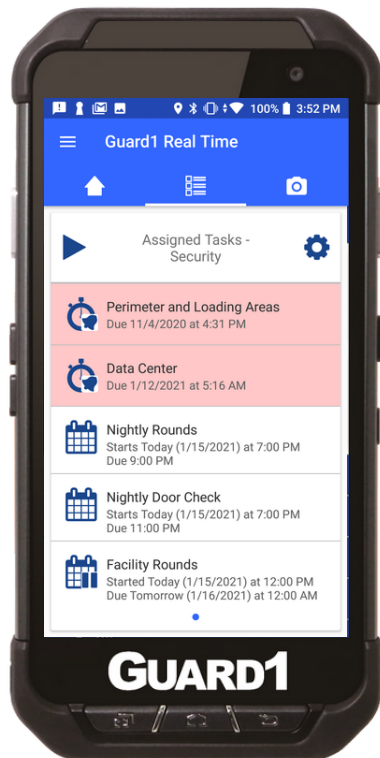


The Task Reminder List provides your team with a real time itinerary of all location checks and tasks scheduled during their shift. The task will turn red if it is past due.

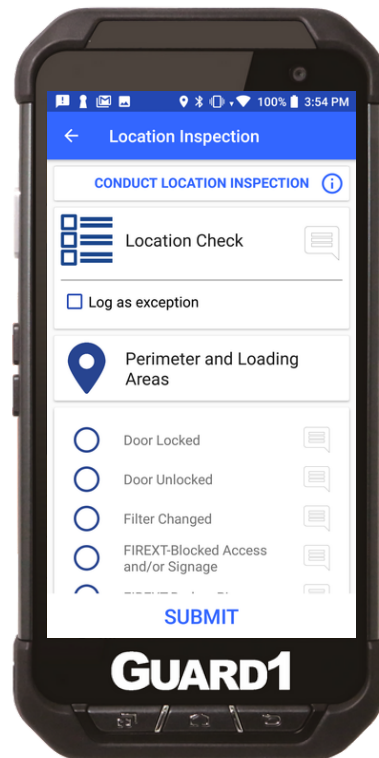

Simply scan the location tag to complete a check. Once the tag is scanned, the location information will populate and you can choose an observation from the list.

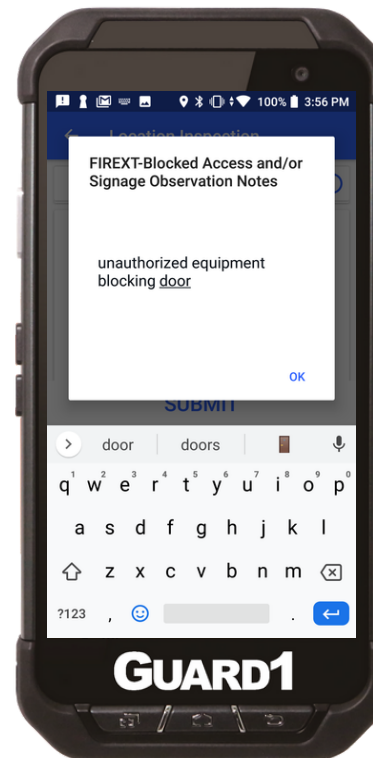

You also have the option to add additional notes to that observation by clicking on the comment bubble to the right of the observation.

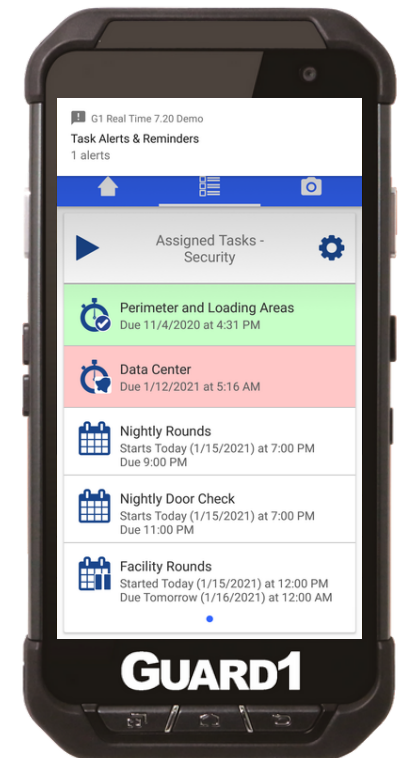

Once the check is submitted, the task will turn green for a moment and then disappear from the list until it is due again.

Full electronic logs.

Don't dig through file cabinets and folders looking for specific paper logs. Find activity logs for a given time period in seconds.

Protection from liability.

With Guard1, you know if a task was completed and logged. If anything was missed, you know it immediately with Guard1 real time alerts.

Powerful reporting.

Ensure the accuracy of your logs and other data. Have an extensive digital record of every event and activity in your facility available on-demand.

Fire Extinguisher Inspection Report				
Detail				
Date Range:	From	9/1/2020 12:00 AM	To	9/16/2020 12:00 AM
Calendar rules:	Calendar Rule: Monthly Fire Extinguisher Inspection			
People:	None			
Assets:	All			
Locations:	None			
Zones:	None			
Activities:	All			
Handouts:	None			
Observations:	All			
Assigned home zones:	All			
Generated at:			09/15/2020 08:32 AM	

Monthly Fire Extinguisher Inspection		75% Compliance	
From: 09/01/2020 12:00 AM	To: 10/01/2020 12:00 AM (*Partial data)	75% Compliance	
Name	Time	Logged by	Description
Fire Ext A1-2 Sally	09/14/2020 09:27 AM	Beaton, Roderick (List)	Activity: Fire Ext Inspection.
Fire Ext A1-2 Sally	09/14/2020 09:27 AM	Beaton, Roderick (List)	Observation: Accessible.
Fire Ext A1-2 Sally	09/14/2020 09:27 AM	Beaton, Roderick (List)	Observation: Pin Intact.
Fire Ext A1-2 Sally	09/14/2020 09:27 AM	Beaton, Roderick (List)	Observation: Pressure = GREEN.
Fire Ext A3-4 Sally	09/14/2020 10:47 AM	Beaton, Roderick (List)	Activity: Fire Ext Inspection.
Fire Ext A3-4 Sally	09/14/2020 10:47 AM	Beaton, Roderick (List)	Observation: Accessible.
Fire Ext A3-4 Sally	09/14/2020 10:47 AM	Beaton, Roderick (List)	Observation: Pin Intact.
Fire Ext A3-4 Sally	09/14/2020 10:47 AM	Beaton, Roderick (List)	Observation: [Warning] Pressure = RED. recharge extinguisher needed.
Fire Ext B1-2 Sally	09/14/2020 11:13 AM	Beaton, Roderick (List)	Activity: Fire Ext Inspection.
Fire Ext B1-2 Sally	09/14/2020 11:13 AM	Beaton, Roderick (List)	Observation: Accessible.
Fire Ext B1-2 Sally	09/14/2020 11:13 AM	Beaton, Roderick (List)	Observation: Pin Intact.
Fire Ext B1-2 Sally	09/14/2020 11:13 AM	Beaton, Roderick (List)	Observation: Pressure = GREEN.
Fire Ext B3-4 Sally	N/A	N/A	Missed

Monthly Fire Extinguisher Inspection		100% Compliance	
From: 09/01/2020 12:00 AM	To: 10/01/2020 12:00 AM (*Partial data)	100% Compliance	
Name	Time	Logged by	Description
Fire Ext A1-2 Sally	09/14/2020 09:27 AM	Beaton, Roderick (List)	Activity: Fire Ext Inspection.
Fire Ext A1-2 Sally	09/14/2020 09:27 AM	Beaton, Roderick (List)	Observation: Accessible.
Fire Ext A1-2 Sally	09/14/2020 09:27 AM	Beaton, Roderick (List)	Observation: Pin Intact.
Fire Ext A1-2 Sally	09/14/2020 09:27 AM	Beaton, Roderick (List)	Observation: Pressure = GREEN.
Fire Ext A3-4 Sally	09/14/2020 10:47 AM	Beaton, Roderick (List)	Activity: Fire Ext Inspection.
Fire Ext A3-4 Sally	09/14/2020 10:47 AM	Beaton, Roderick (List)	Observation: Accessible.
Fire Ext A3-4 Sally	09/14/2020 10:47 AM	Beaton, Roderick (List)	Observation: Pin Intact.
Fire Ext A3-4 Sally	09/14/2020 10:47 AM	Beaton, Roderick (List)	Observation: [Warning] Pressure = RED. recharge extinguisher needed.
Fire Ext B1-2 Sally	09/14/2020 11:13 AM	Beaton, Roderick (List)	Activity: Fire Ext Inspection.
Fire Ext B1-2 Sally	09/14/2020 11:13 AM	Beaton, Roderick (List)	Observation: Accessible.
Fire Ext B1-2 Sally	09/14/2020 11:13 AM	Beaton, Roderick (List)	Observation: Pin Intact.
Fire Ext B1-2 Sally	09/14/2020 11:13 AM	Beaton, Roderick (List)	Observation: Pressure = GREEN.
Fire Ext B3-4 Sally	09/15/2020 08:32 AM	Beaton, Roderick (List)	Activity: Fire Ext Inspection.
Fire Ext B3-4 Sally	09/15/2020 08:32 AM	Beaton, Roderick (List)	Observation: Accessible.
Fire Ext B3-4 Sally	09/15/2020 08:32 AM	Beaton, Roderick (List)	Observation: Pin Intact.
Fire Ext B3-4 Sally	09/15/2020 08:32 AM	Beaton, Roderick (List)	Observation: Pressure = GREEN.



**Protecting lives
and reputations**

1-800-THE-PIPE
sales@guard1.com
www.guard1.com

TimeKeeping Systems, Inc.
30700 Bainbridge Road
Solon, Ohio 44139
216-595-0890